


PC 53U Power Meter
SCADA

■ LOCAL CONNECTION

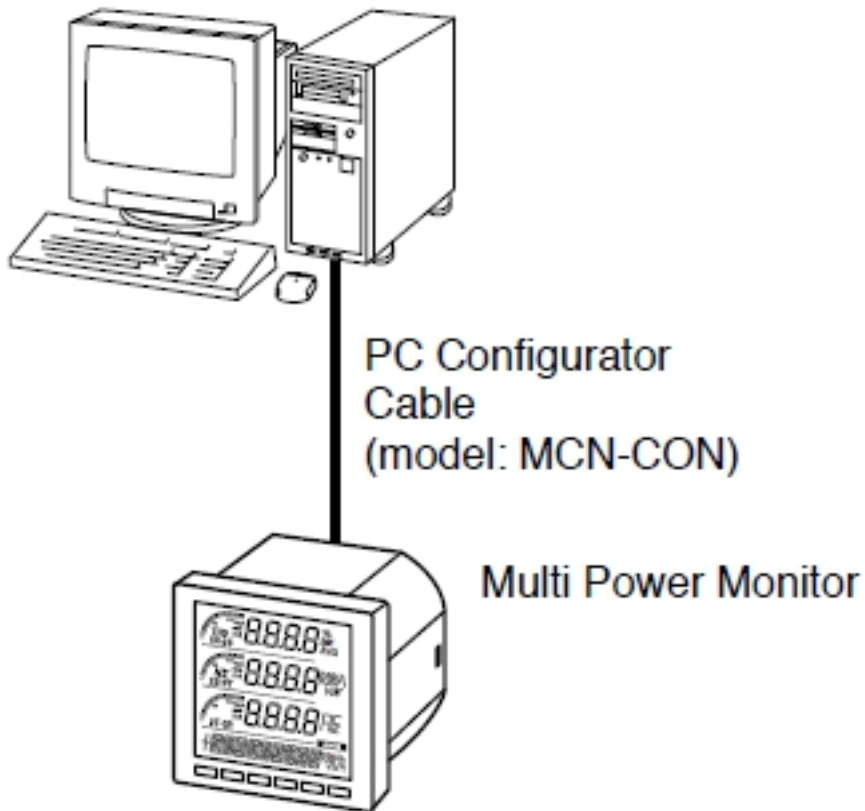


1 Local Connection

Written by Administrator

Monday, 18 January 2010 18:04 - Last Updated Monday, 18 January 2010 11:09

Communication 53U Power Meter
53U Power Meter PC COM Port
1 3
Power Meter Power
Modbus

NETWORK CONNECTION (RS-485)

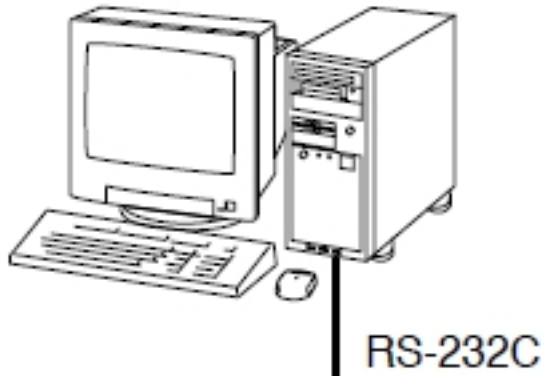


R2K-1 / LK1


Set individual node address to each device.
Modbus setting for all connected devices must be identical (baud rate, parity, stop bit).

The RS-485 and the MCN-CON cannot operate at once.

Analog output level is fixed while in the communication mode.

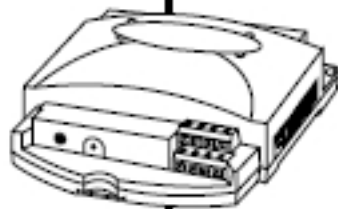

RS-232C/RS-485 Converter
(model: R2K-1 or LK1)

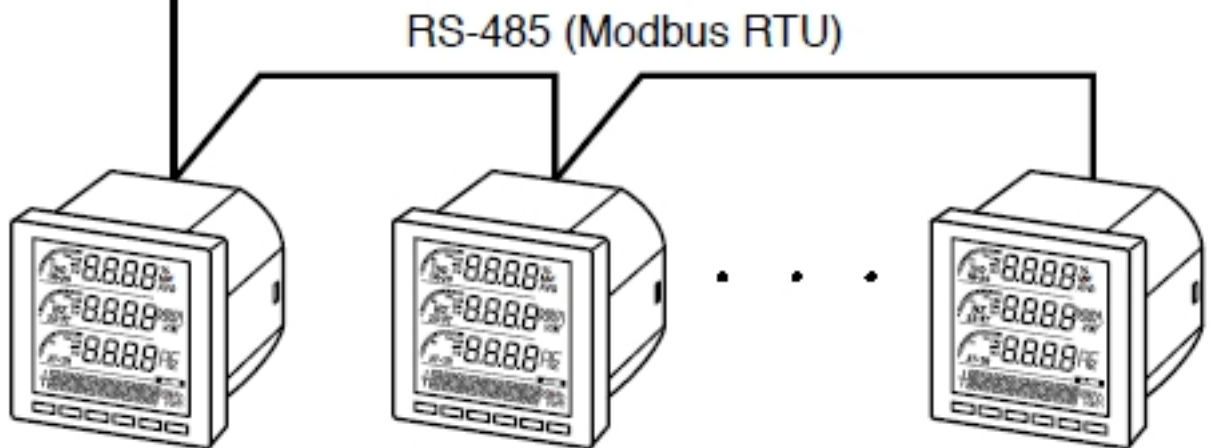


Multi Power Monitor

Written by Administrator

Monday, 18 January 2010 18:04 - Last Updated Monday, 18 January 2010 11:09

NETWORK CONNECTION (Ethernet)

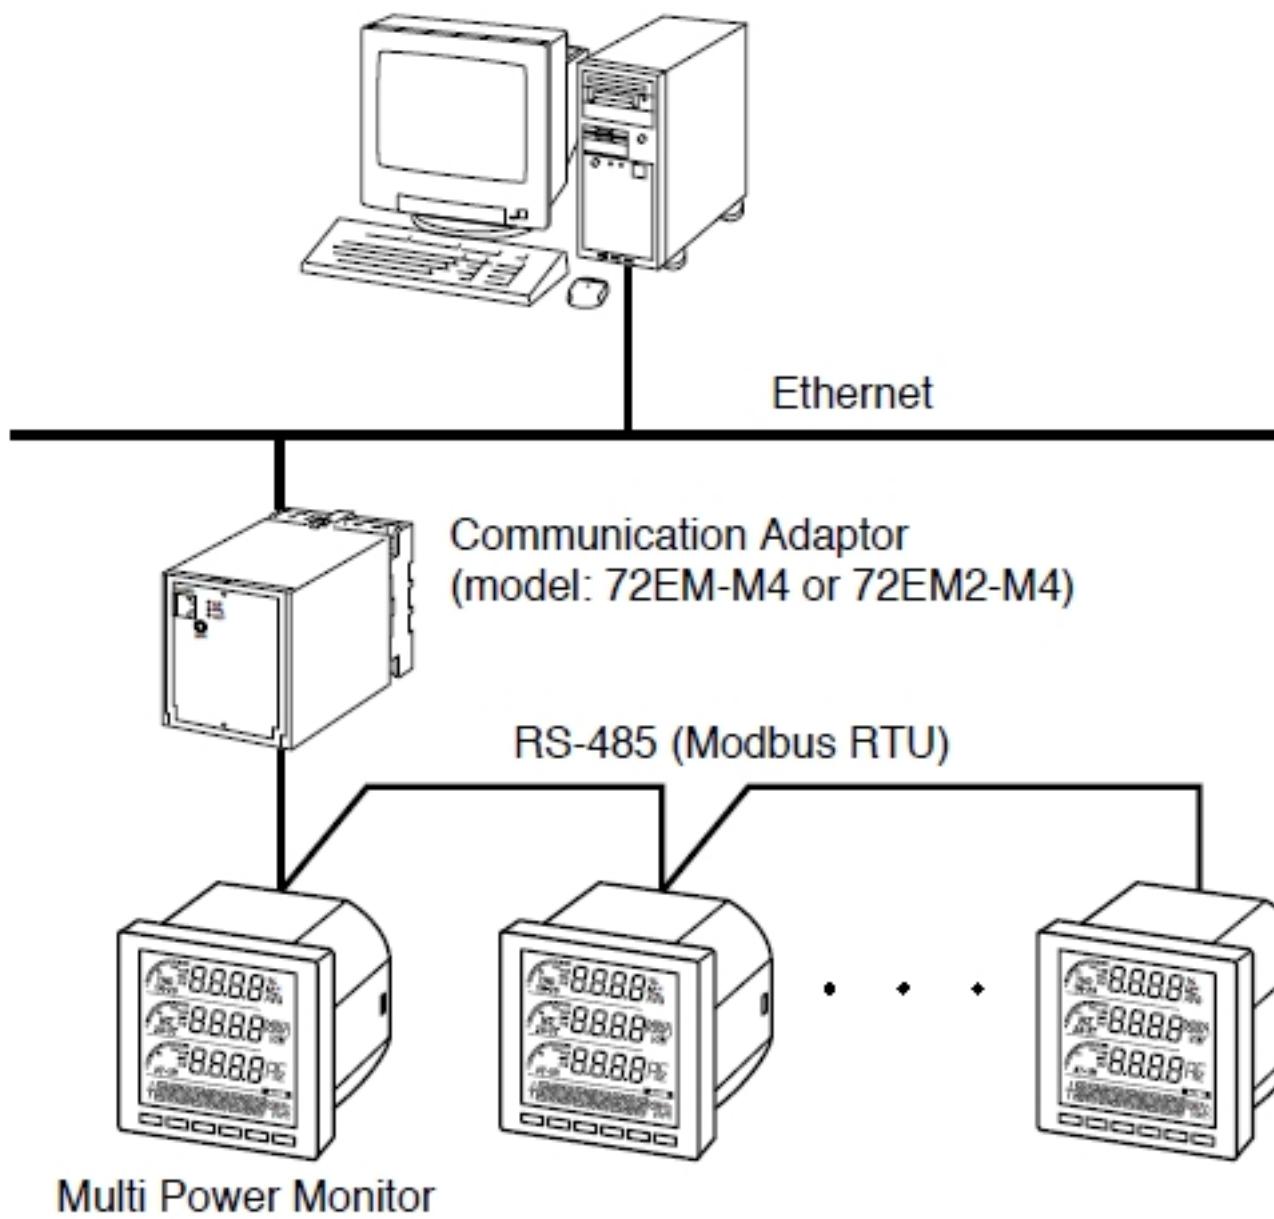

Network Connection (Ethernet) RS-485 (Modbus RTU)